# GLOBAL IMPACT PRODUCTS, LLC.


# SERIES 3063 - FIXED ALUMINUM WINDOW (HVHZ)(IMPACT)

## **GENERAL NOTES:**

- 1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC), **INCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
  - TAS 201-94
  - TAS 202-94
  - TAS 203-94
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING, AND METAL FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 4. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/4 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- 5. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
- 6. APPROVED IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED
  ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE
- 7. WINDOW FRAME MATERIAL: ALUMINUM (6063-T5)
- 8. GLASS MEETS THE REQUIREMENTS OF ASTM E 1300 GLASS CHARTS. SEE SHEET 1 FOR GLAZING DETAIL.

DESIGN RATING							
OVERA	ALL SIZE		DESIGN	MISSILE IMPACT			
WIDTH	HEIGHT	CONFIGURATION	PRESSURE	RATING			
60" x 120"		"0"	+100/-100 PSF	LARGE & SMALL MISSILE IMPACT RATED			

	TABLE OF CONTENTS
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES AND GLAZING DETAIL
2	ELEVATION AND ANCHOR LAYOUTS
3	VERTICAL SECTION
4	HORIZONTAL SECTION
5	ANCHOR DETAILS AND INSTALLATION NOTES
6	COMPONENTS AND BILL OF MATERIALS

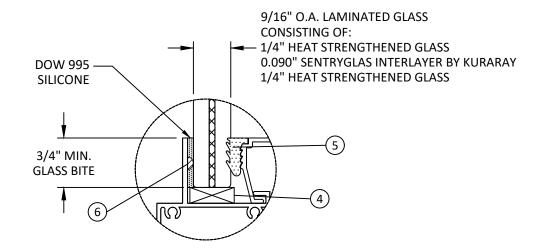

# **GLAZING DETAIL 1**

#### GLAZING NOTES:

- 1. GLASS TYPE COMPLIES WITH ASTM E1300 REQUIREMENTS.
  PER THE FBC TEMPER AND SAFETY GLAZING REQUIREMENTS
  SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
- SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
- 3. SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
- 4. D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES SHOWN HEREIN.




GLOBAL IMPACT PRODUCTS 1963 WEST MCNAB RD, POMPANO BEACH, FL 33069 PH: (561) 346-3649

3063 - FIXED ALUMINUM WINDOW (HVHZ)(IMPACT) GENERAL NOTES AND GLAZING DETAIL

(HVHZ)
GENERAL
GLAZIN
PREPARED BY:

REMARKS BY DATE

IND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIAT FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL46906


DATE: **07.12.2024**DWG. BY: CHK. BY:


FB SCALE: NTS

DWG. #: **GIP008** 

SHEET:

1

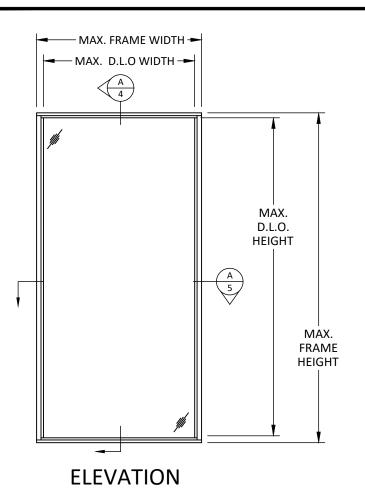

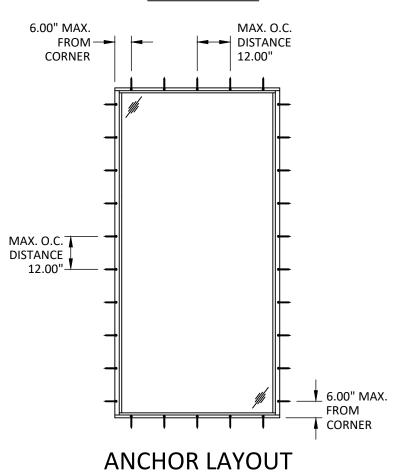

THROUGH FRAME

SERIES 3063 - FIXED WINDOW DESIGN PRESSURE TABLE (+/- PSF)																					
FRAME WIDTH (IN.)																					
		36	42	48	54	60	66	72	78	84	90	96	102	108	114	120	126	132	138	144	150
	48	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0
	54	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	-	-	-
	60	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	-	-	-	-	1
	66	100.0	100.0	100.0	100.0	100.0	90.9	90.9	90.9	90.9	90.9	90.9	90.9	90.9	ı	1	-	-	1	-	-
	72	100.0	100.0	100.0	100.0	100.0	90.9	83.3	83.3	83.3	83.3	83.3	-	-	-	-	-	-	-	-	-
	78	100.0	100.0	100.0	100.0	100.0	90.9	83.3	76.9	76.9	76.9	-	-	-	-	-	-	-	-	-	-
	84	100.0	100.0	100.0	100.0	100.0	90.9	83.3	76.9	71.4	-	-	-	-	-	-	-	-	-	-	-
FRAME	90	100.0	100.0	100.0	100.0	100.0	90.9	83.3	76.9	-	-	-	-	-	-	-	-	-	-	-	-
HEIGHT	96	100.0	100.0	100.0	100.0	100.0	90.9	83.3	-	-	-	-	-	-	-	-	-	-	-	-	-
(IN.)	102	100.0	100.0	100.0	100.0	100.0	90.9	-	-	-	-	-	-	-	-	-	-	-	-	-	-
(114.)	108	100.0	100.0	100.0	100.0	100.0	90.9	-	-	-	-	-	-	-	-	-	-	-	_	-	-
	114	100.0	100.0	100.0	100.0	100.0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	120	100.0	100.0	100.0	100.0	100.0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	126	100.0	100.0	100.0	100.0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	132	100.0	100.0	100.0	100.0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	138	100.0	100.0	100.0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	144	100.0	100.0	100.0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	150	100.0	100.0	100.0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	156	100.0	100.0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

# **FIXED WINDOW - D.L.O. DIMENSIONS:**

D.L.O. HEIGHT: FRAME HEIGHT - 2-9/16" D.L.O. WIDTH: FRAME WIDTH - 2-9/16"

NOTE: SEE SHEET 5 FOR ANCHOR DETAILS.



1963 WEST MCNAB RD, POMPANO BEACH, FL 33069 PH: (561) 346-3649

BUILDING DROPS, 1900 NE MIAMI CT. SUITE 2-

TITLE:

SERIES 3063 - FIXED ALUMINUM

WINDOW


(HVHZ)(IMPACT)

ELEVATION AND

DESIGN PRESSURE TABLE

BY DATE REMARKS

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERI AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATI FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



1900 NE MIAMI CT. SUITE 2-15 MIAMI, FL 33132 FBPE CERT. OF AUTHORIZATION No. 29578

FL46906

DATE: 07.12.2024

DWG. BY:


CHK. BY: NTS

DWG. #:

GIP008

SHEET:

SCALE:

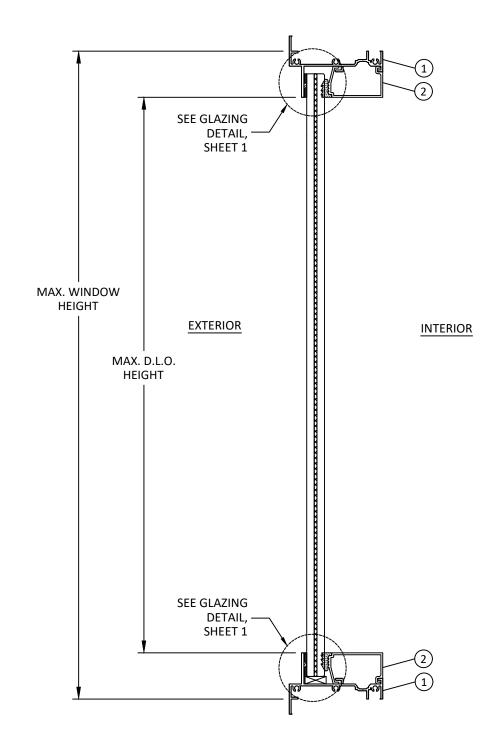





GLOBAL IMPACT PRODUCTS 1963 WEST MCNAB RD, POMPANO BEACH, FL 33069 PH: (561) 346-3649

TITLE:

SERIES 3063 - FIXED ALUMINUM

WINDOW

(HVHZ)(IMPACT)

VERTICAL SECTION

BUILDING DROPS, I.

BUILDING DROPS, I.

1900 NE MIANI, FL 33132
PH: (954)399-8478
FAX: (954)7444738
S WEB: www.buildingdrops.com

BY DATE REMARKS

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

FL #: FL46906

DATE: 07.12.2024

DWG. BY: CHK. BY:

NTS SCALE: GIP008 DWG. #:

SHEET:





GLOBAL IMPACT PRODUCTS 1963 WEST MCNAB RD, POMPANO BEACH, FL 33069 PH: (561) 346-3649

TITLE:

SERIES 3063 - FIXED ALUMINUM

WINDOW

(HVHZ)(IMPACT)

HORIZONTAL SECTION

BUILDING DROPS, I.

BUILDING DROPS, I.

1900 NE MIANI, FL 33132

PHX: (954)399-8478

FAX: (954)7444738

WEB: www.buildingdrops.com

BY DATE REMARKS

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

NO 73778

STATE OF

STATE OF

FORDAPE NO REA

BUILDING BRODS, INC

1900 NE MIAMI CT. SUITE 2-15

MIAMI, FL 33132

FBPE CERT. OF AUTHORIZATION No. 29578

FL #:

FL46906

DATE: 07.12.2024

DWG. BY: SCALE:

CHK. BY: NTS

GIP008 DWG. #:

SHEET:



MIN. EDGE
DISTANCE
PERIMETER
SEALANT BY
OTHERS

EXTERIOR


SEE ANCHOR SCHEDULE
ON SHEET 3

SUBSTRATE BY OTHERS


MIN.
EMBEDMENT

1/4" MAX.
SHIM SPACE



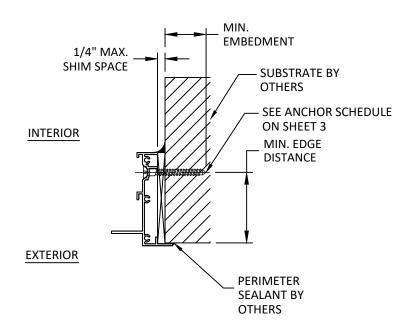



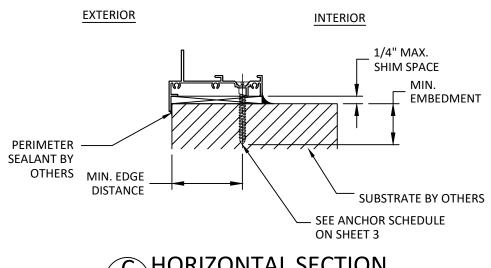

$\overline{C}$	HORIZONTAL SECTION
5	TYP. SILL INSTALLATION THROUGH FRAME

ANCHOR SCHEDULE - SERIES 3063 FIXED ALUMINUM WINDOW							
INST. METHOD	ANCHOR TYPE SUBSTRATE MIN. EMBEDMENT MIN. EDGE DISTA						
	#14 WOOD SCREW	WOOD (S.G. = 0.55)	1.50"	0.50"			
THROUGH FRAME	1/4" SELF-TAPPING SCREW	MIN. 18 GA. STEEL (33KSI)/ ALUMINUM 1/8" MIN. THK. 6063-T5	THREE (3) THREADS MIN PENETRATION BEYOND METAL FACE	0.50"			
	1/4" ULTRACON+	CONCRETE: f'c = 3000 PSI	1.25"	2.00"			
	1/4" ULTRACON+	MASONRY : CMU PER ASTM-C90, MIN. 2000 PSI	1.75"	2.00"			

### **INSTALLATION NOTES:**

- 1. ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN, UNLESS OTHERWISE STATED ON SHEET 3.
- 2. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1.000 INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- 3. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- 4. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING
- 5. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- 6. FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
- 7. FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- 8. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.



GLOBAL IMPACT PRODUCTS 1963 WEST MCNAB RD, POMPANO BEACH, FL 33069 PH: (561) 346-3649

TTLE:

SERIES 3063 - FIXED ALUMINUM

WINDOW

(HVHZ)(IMPACT)

ANCHOR DETAILS AND
INSTALLATION NOTES

REPARED BY:

BUILDING DROPS, IN
1900 NE MANI CT. SUITE 2-15

⊥	Ы		
REMARKS		BY	DATE

'HE INSTALLATION DETAILS DESCRIBED HEREIN ÂRE GENER AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIF SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIA' FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSEE ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 295.

FL46906

DATE: 07.12.2024


DWG. BY: CHK. BY: HFN


SCALE: NTS
DWG. #: GIP008


SHEET:

5

BILL OF MATERIALS									
ITEM	PART No.	DESCRIPTION	MATERIAL	MANUF./SUPPLIER/REMARKS					
1	021-024	FRAME HEAD/SILL/JAMBS	6063-T5	ARCH ALUM					
2	021-020	GLAZING STOP	6063-T5	-					
3	012-003	DOW 995	SILICONE	DOW CORNING					
4	015-008	SETTING BLOCK	NEOPRENE	FRANK LOWE RUBBR					
5	015-007	WEDGE GASKET	VINYL	MASTER TOOL					
6	015-006	0.150 SPACER	VINYL	FRANK LOWE RUBBR					







GLOBAL IMPACT
W PRODUCTS
MANUFACTURER WINDOWS & DOORS

GLOBAL IMPACT PRODUCTS 1963 WEST MCNAB RD, POMPANO BEACH, FL 33069 PH: (561) 346-3649

TITLE:

SERIES 3063 - FIXED ALUMINUM

WINDOW

(HVHZ)(IMPACT)

COMPONENTS AND BILL OF


MATERIALS

BUILDING DROPS, I.

1900 NE MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744.4738

REMARKS BY DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #: FL46906

DATE: 07.12.2024

DWG. BY: SCALE:

CHK. BY: NTS

DWG. #:

GIP008

SHEET:

6